




Real-Time Multigas Monitoring Bristol Landfill Air Investigation January 13 - January 19, 2025




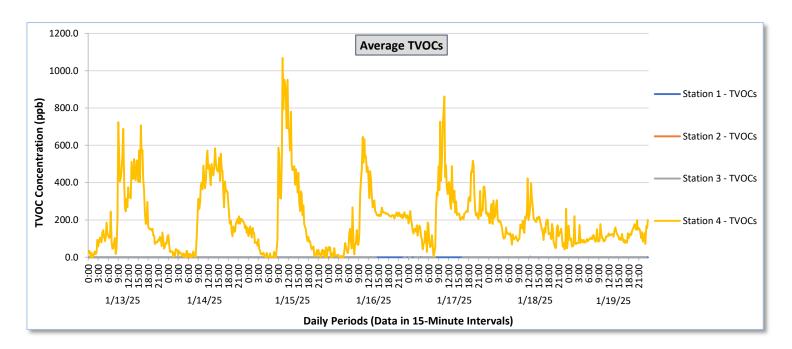

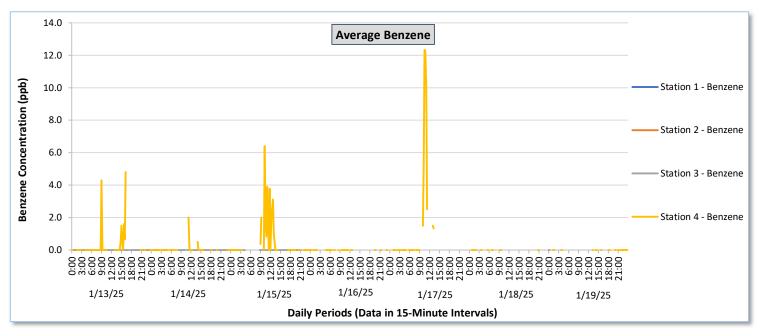


Real-Time Multigas Monitoring Bristol Landfill Air Investigation January 13 - January 19, 2025

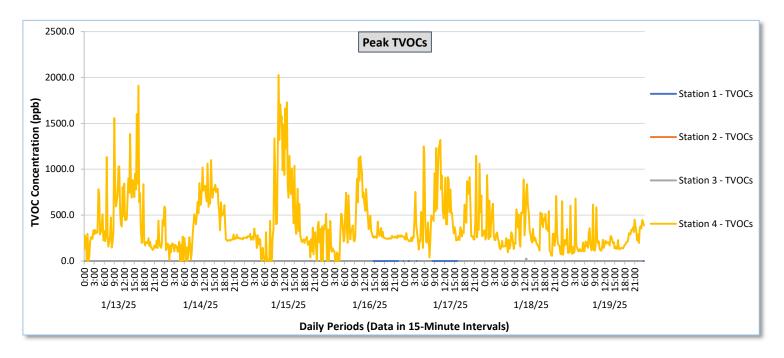


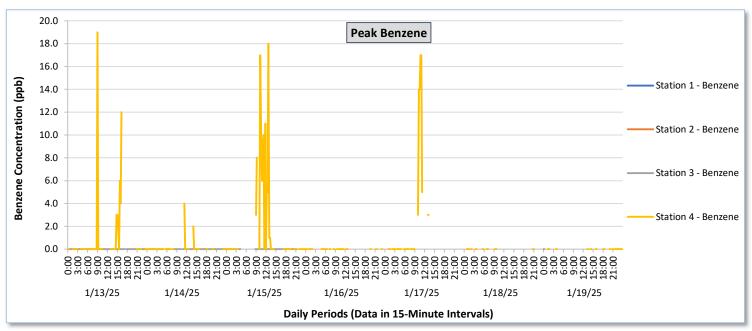



Real-Time Multigas Monitoring Bristol Landfill Air Investigation January 13 - January 19, 2025

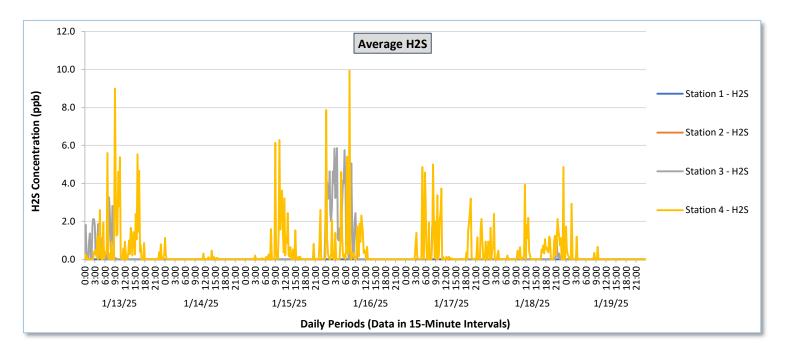

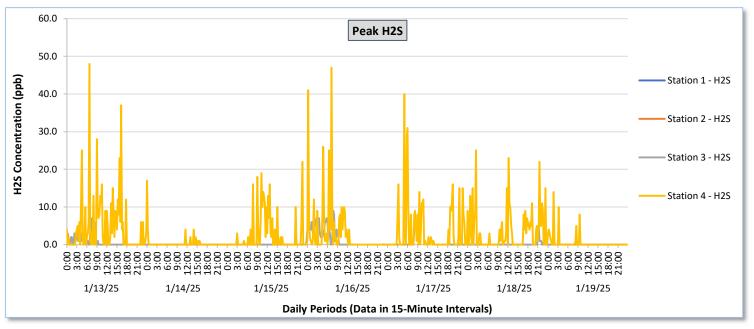



Real-Time Multigas Monitoring Bristol Landfill Air Investigation January 13 - January 19, 2025

		Station 1						Station 2				Station 3				Station 4									
Date	Daily Statistics	TVOCs H2S			Benzene		TVOCs H2S		25	Benzene		TVOCs H2S			Ben	Benzene TVO		OCs H2S		Benzene					
		Average	Peak ppb	Average	Peak ppb	Average	Peak ppb	Average	Peak ppb	Average	Peak ppb	Average	Peak ppb	Average	Peak ppb										
		Values from 15-minute intervals.	1-minute max within each 15 minute interval.	Values from 15- minute intervals.	1-minute max within each 15 minute interval.																				
January 13, 2025	Minimum	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	0.0	0.0	-	-	0.0	0.0	0.0	0.0	0.0	0.0
	Maximum	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	3.3	7.0		-	723.5	1,910.0	9.0	48.0	4.8	19.0
	Average	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	0.3	0.8	-	-	215.2	459.6	0.8	4.7	0.2	0.8
January 14, 2025	Minimum	0.0	0.0	0.0	0.0						-			0.0	0.0	0.0	0.0	-		0.0	0.0	0.0	0.0	0.0	0.0
	Maximum	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	0.0	0.0		-	583.9	1,101.0	1.1	17.0	2.0	4.0
	Average	0.0	0.0	0.0	0.0	-		-	-	-	-	-	-	0.0	0.0	0.0	0.0	-	-	217.9	384.9	0.0	0.4	0.1	0.2
January 15, 2025	Minimum	0.0	0.0	0.0	0.0									0.0	0.0	0.0	0.0			0.0	0.0	0.0	0.0	0.0	0.0
	Maximum	0.0	0.0	0.0	0.0	-	_			-	-	-	-	0.0	0.0	0.1	1.0			1,068.5	2,026.0	6.3	22.0	6.4	18.0
	Average	0.0	0.0	0.0	0.0	-	_				-			0.0	0.0	0.0	0.0			212.4	456.9	0.4	2.5	0.5	1.7
January 16, 2025	Minimum	0.0	0.0	0.0	0.0		•	-	-	-	-	-	-	0.0	0.0	0.0	0.0	-	-	0.0	0.0	0.0	0.0	0.0	0.0
	Maximum	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	5.9	9.0	-	-	644.5	1,140.0	9.9	47.0	0.0	0.0
	Average	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	1.6	2.5	•	-	196.7	354.3	0.5	3.1	0.0	0.0
2025	Minimum	0.0	0.0	0.0	0.0	-	-		-	-	-	-	-	0.0	0.0	0.0	0.0	-	-	3.8	37.0	0.0	0.0	0.0	0.0
January 17, 2025	Maximum	0.0	0.0	0.0	0.0	-	-		-	,	-			0.0	0.0	1.8	4.0		-	862.4	1,319.0	5.0	40.0	12.3	17.0
	Average	0.0	0.0	0.0	0.0	-	-	-	-	-	-	-	-	0.0	0.0	0.0	0.1	-	-	264.7	486.1	0.6	3.5	1.2	2.0
January 18, 2025	Minimum	0.0	0.0	0.0	0.0			-		-	-	-	-	0.0	0.0	0.0	0.0			42.0	59.0	0.0	0.0	0.0	0.0
	Maximum	0.0	0.0	0.0	0.0			-			-			4.0	27.0	1.1	5.0			422.2	936.0	4.9	25.0	5.8	11.0
	Average	0.0	0.0	0.0	0.0			-		-	-	-		0.0	0.3	0.0	0.1		-	164.0	317.8	0.4	3.4	0.5	0.9
January 19, 2025	Minimum	0.0	0.0	0.0	0.0									0.0	0.0	0.0	0.0			57.3	79.0	0.0	0.0	0.0	0.0
	Maximum	0.0	0.0	0.0	0.0									0.0	0.0	0.0	0.0			220.2	681.0	2.9	14.0	0.0	0.0
	Average	0.0	0.0	0.0	0.0									0.0	0.0	0.0	0.0			113.0	220.8	0.1	0.5	0.0	0.0
Notes:		0.0	0.0	0.0	0.0									0.0	0.0	0.0	0.0			113.0	220.0	0.1	0.5	0.0	0.0

Notes:
- Data records with a dash indicate no data is available for that interval.

- Calibration readings and data produced during periods of sensor downtime and/or maintenance are excluded from the report.
- Station 2 shut down 7/30/2024 and is undergoing maintenance.
- The CTair monitoring systems at each station are programmed to initiate benzene sampling when a TVOC reading of ≥ 160 ppb is measured. It has been observed that there are occurrences of TVOC readings ≥ 160 ppb where the benzene sampling was not initiated. The affected stations and periods are detailed in the monitoring systems daily reports. The equipment supplier has been notified of this issue and a corrective action will be implemented when provided.
- As discussed with the manufacturer of the H2S sensor, there is high likelihood that the H2S sensor has cross sensitivity with other sulfur compounds, including, but are not limited to, carbonyl sulfide, dimethyl sulfide, dimethyl disulfide, and methyl mercaptan. The potential for cross sensitivity with other reduced sulfur compounds must be considered when interpreting H2S levels recorded by the sensors.
- Station 3 recorded a TVOC event with a measured TVOC value of approximately 65,000 parts per billion (ppb) beginning at 0030 on 1/19/2025 through 0100 on 1/19/2025. This value affected the scaling of the TVOC graphs which resulted in no resolution for the TVOC data for corded at the Stations 1, 3, and 4 for the balance of this reporting period. As a result, the Station 3 TVOC event data has been excluded from this report to display meaningful data for Stations 1, 3, and 4. The complete Station 3 TVOC data for the period ending 1/19/2025 is presented separately.



Real-Time Multigas Monitoring Bristol Landfill Air Investigation

January 13 - January 19, 2025

		Bristol Met Station											
Date	Daily Statistics	Wind Direction degrees	Wind Speed	Temperature	Relative Humidity	Barometric Pressure _{mbar}							
2025	Minimum		0.0	20.5	71.1	952.0							
January 13, 2025	Maximum		8.0	36.6	86.4	954.8							
Janus	Average	187.6	1.6	29.6	78.4	953.2							
025	Minimum		0.0	19.8	39.7	954.6							
January 14, 2025	Maximum		15.0	35.9	81.5	958.9							
Janua	Average	237.0	3.6	28.1	61.1	956.5							
2025	Minimum		0.0	14.7	45.3	957.1							
January 15, 2025	Maximum		10.0	32.1	71.5	962.4							
Janus	Average	229.0	2.3	24.1	59.9	959.5							
2025	Minimum		0.0	18.2	52.4	945.8							
January 16, 2025	Maximum		15.0	42.6	74.7	957.1							
Janus	Average	128.4	2.1	25.7	67.4	950.4							
025	Minimum		0.0	26.2	31.1	946.3							
January 17, 2025	Maximum		8.0	49.1	88.3	953.9							
Janua	Average	181.9	1.8	35.1	63.7	950.3							
025	Minimum		0.0	34.2	59.4	940.4							
ורץ 18, 2025	Maximum		15.0	47.7	96.1	946.3							
January	Average	198.9	1.7	40.7	83.4	943.0							
:025	Minimum		0.0	20.8	75.4	940.5							
January 19, 2025	Maximum		16.0	40.6	96.3	953.0							
Janua	Average	286.5	3.2	31.8	91.0	944.6							

Notes:

- Dash/Blank data records indicate no data is available for that interval.
- Wind direction is a daily (24-hr) average value; with the origin of wind in degrees; clockwise from North calculated with vector averaging.